


8 INCH REINFORCED CONCRETE MASONRY WALL

H	X	A	B	T	Y-BARS	X-BARS
11'-0"	11'-0"	11'-0"	11'-0"	11'-0"	11'-0"	11'-0"
10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"
9'-0"	9'-0"	9'-0"	9'-0"	9'-0"	9'-0"	9'-0"
8'-0"	8'-0"	8'-0"	8'-0"	8'-0"	8'-0"	8'-0"
7'-0"	7'-0"	7'-0"	7'-0"	7'-0"	7'-0"	7'-0"
6'-0"	6'-0"	6'-0"	6'-0"	6'-0"	6'-0"	6'-0"
5'-0"	5'-0"	5'-0"	5'-0"	5'-0"	5'-0"	5'-0"
4'-0"	4'-0"	4'-0"	4'-0"	4'-0"	4'-0"	4'-0"
3'-0"	3'-0"	3'-0"	3'-0"	3'-0"	3'-0"	3'-0"
2'-0"	2'-0"	2'-0"	2'-0"	2'-0"	2'-0"	2'-0"
1'-0"	1'-0"	1'-0"	1'-0"	1'-0"	1'-0"	1'-0"
0'-0"	0'-0"	0'-0"	0'-0"	0'-0"	0'-0"	0'-0"

- GENERAL NOTES:**
- ALL CONCRETE IS TO BE 4000 PSI @ 28 DAYS.
 - MINIMUM COMPACTION UNDER FOOTINGS IS TO BE 95% PER TO BE 4.202C.
 - BACK FILL AGAINST WALLS IS TO BE HAND-PLACED AND
 - ALL BARS ARE TO BE GRADE 60, ASTM A615.
 - REINFORCEMENT SHALL BE AT LEAST EQUAL IN SIZE AND SPACING TO V-BARS. SMALL PROTECT A MINIMUM OF 30 BAR TO THE TOP OF THE FOOTING.
 - PROTECT REINFORCEMENT AND WALLS WHERE OVERLAP STEERS EVERY 16" TO BE USED ON WALLS EXCEEDING 7'-8" HEIGHT.
 - ALL BARS TO BE USED ON WALLS SMALLER THAN 2'-8" HEIGHT.
 - FOR WALLS UNDER 5'-4", 2-#5 BARS FOR WALLS OVER 5'-4".

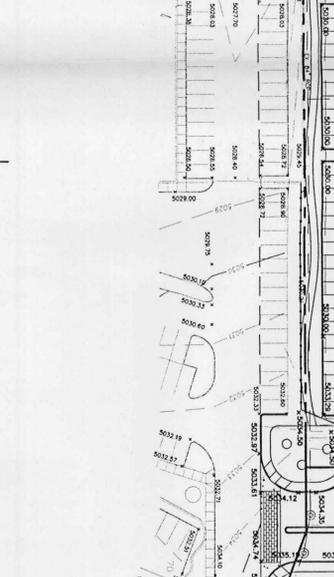

- EROSION CONTROL PLAN UNDER PERMIT AND POLLUTION PREVENTION NOTES**
- CONTRACTOR IS RESPONSIBLE FOR OBTAINING A TOPSOIL DISTURBANCE PERMIT PRIOR TO BEGINNING WORK.
 - CONTRACTOR IS RESPONSIBLE FOR CLEANING ALL SEDIMENT OUT OF EXISTING RIGHT-OF-WAY.
 - CONTRACTOR IS RESPONSIBLE FOR MAINTAINING ALL STORM RUN OFF ON SITE.
 - REPAIR OF DAMAGED FACILITIES AND CLEAN-UP OF SEDIMENT ACCUMULATION ON ADJACENT PROPERTIES AND IN PUBLIC FACILITIES IS THE RESPONSIBILITY OF THE CONTRACTOR.
 - ALL EXPOSED EARTH SURFACES MUST BE PROTECTED FROM WIND AND WATER EROSION PRIOR TO FINAL ACCEPTANCE OF ANY PROJECT.
 - CONTRACTOR IS RESPONSIBLE FOR OBTAINING NPDES PERMIT FOR THE SITE

