


Figure 24.5

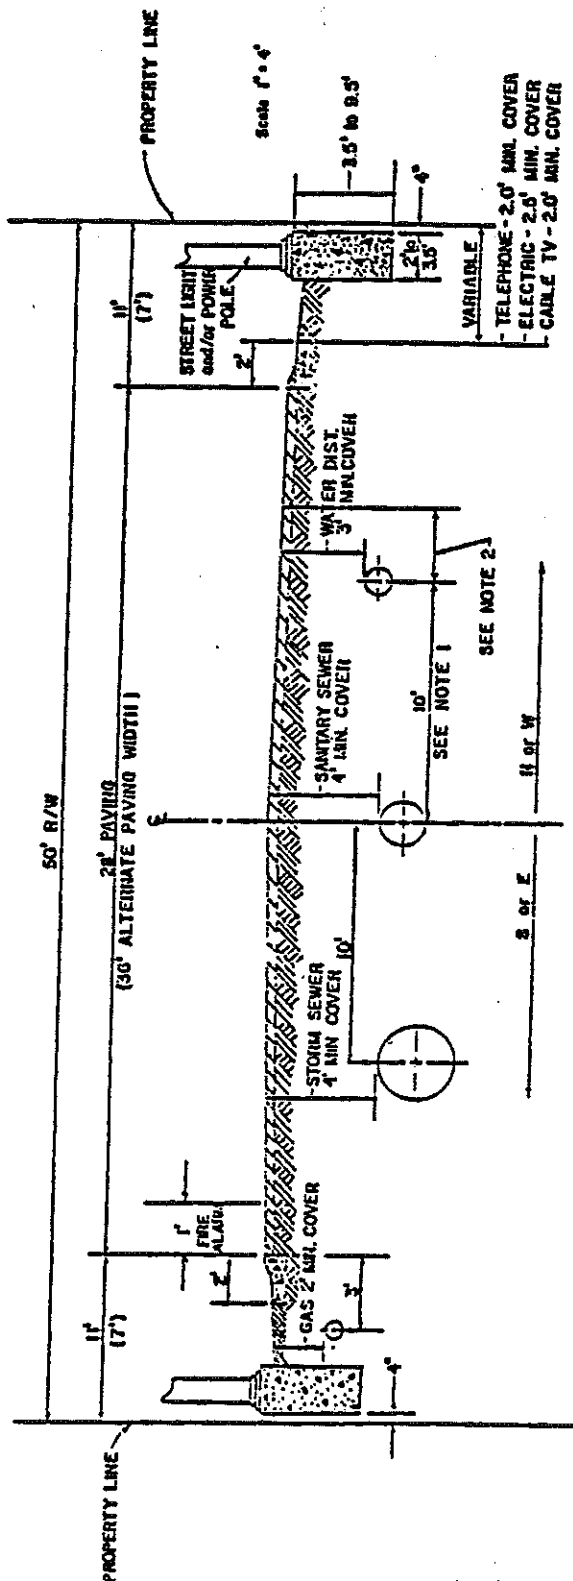

- NOTES**
1. FOR SANITARY SEWER AND/OR WATERLINES GREATER THAN 16" IN DIAMETER, UTILITY LOCATIONS SHOULD BE ADJUSTED FOR 10' MINIMUM SEPARATION OUTSIDE TO OUTSIDE, BETWEEN SEWERS AND WATERLINES IN WHICH CASE THE SANITARY SEWER WILL BE RELOCATED TO THE SOUTH ON EAST.
 2. A MINIMUM OF 6" SEPARATION BETWEEN WATERLINE AND TELEPHONE, ELECTRIC OR CABLE TV LINES IS REQUIRED. A 2" SEPARATION IS ALLOWED BETWEEN WATERLINE AND MANHOLES FOR THESE UTILITIES.
 3. STRICT ADHERENCE TO THESE LOCATIONS MAY NOT ALWAYS BE PRACTICAL; LOCATIONS WILL BE RESOLVED BETWEEN THE INVOLVED UTILITIES.
 4. MINIMUM COVER WILL BE MEASURED BETWEEN THE FINISHED UTILITIES UNDERGROUND LINES.
 5. SIDEWALKS MAY BE INSTALLED.

APPROVALS:

Frank A. Kleinberg
City of Albuquerque

Richard M. ...
Mountain Hill Telephone Company

...
Southern Utility Gas Company

...
Public Service Company of New Mexico

NOVEMBER 6, 1975

| | | |
|------------------------|----|--------------------|
| PRIMARY UTILITY LOCATE | IN | ESTATE TYPE STREET |
|------------------------|----|--------------------|

Primary Utility Locations - Estate Type Streets