


Figure 24.3

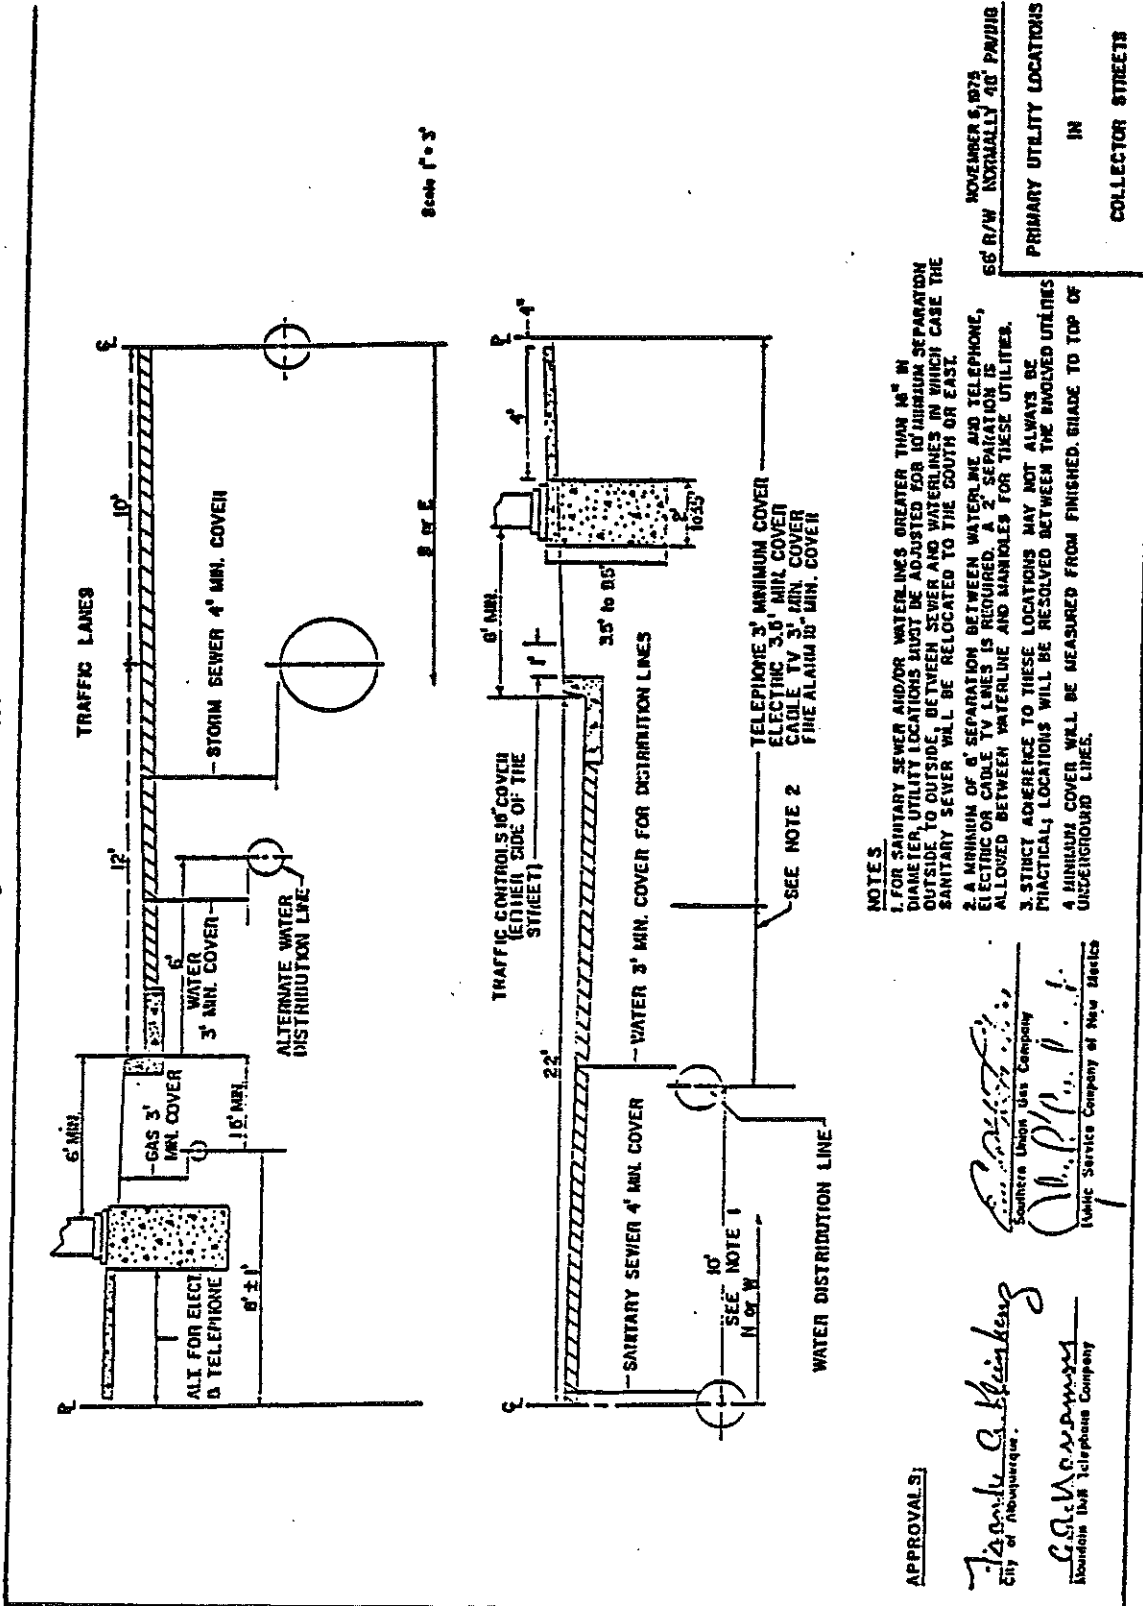

Scale 1" = 3'

**APPROVALS:**

*Richard A. Kleinberg*  
City of Newburgh

*W. P. P. P.*  
Public Service Company of New York

*W. P. P. P.*  
Public Service Company of New York

**NOTES:**

1. FOR SANITARY SEWER AND/OR WATERLINES GREATER THAN 18" IN DIAMETER, UTILITY LOCATIONS MUST BE ADJUSTED FOR 10' MINIMUM SEPARATION OUTSIDE TO OUTSIDE, BETWEEN SEWER AND WATERLINES IN WHICH CASE THE SANITARY SEWER WILL BE RELOCATED TO THE SOUTH OR EAST.
2. A MINIMUM OF 6' SEPARATION BETWEEN WATERLINE AND TELEPHONE, ELECTRIC OR CABLE TV LINES IS REQUIRED. A SEPARATOR IS ALLOWED BETWEEN WATERLINE AND MANHOLES FOR THESE UTILITIES.
3. STRICT ADHERENCE TO THESE LOCATIONS MAY NOT ALWAYS BE PRACTICAL; LOCATIONS WILL BE RESOLVED BETWEEN THE INVOLVED UTILITIES.
4. MINIMUM COVER WILL BE MEASURED FROM FINISHED GRADE TO TOP OF UNDERGROUND LINES.

NOVEMBER 6, 1978  
66' R/W NORMALLY 40' PAVED

PRIMARY UTILITY LOCATIONS  
IN  
COLLECTOR STREETS

Primary Utility Locations - Collector Streets (66' R/W)